

**Drinking Water Quality and Compliance  
For Hamlet of Riverside Estates  
2025 Annual Notice to Consumers**

(Note: This short form may be used for communities or waterworks serving a population of less than 5000).

**Introduction**

The Water Security Agency and the Ministry of Environment requires that at least once each year waterworks owners provide notification to consumers of the quality of water produced and supplied as well as information on the performance of the waterworks in submitting samples as required by a Minister's Order or Permit to Operate a waterworks. The following is a summary of the Hamlet of Riverside Estates water quality and sample submission compliance record for the 2025 time period. This report was completed on February 18, 2026. Readers should refer to Water Security Agency's Municipal Drinking Water Quality Monitoring Guidelines, June 2015, EPB 502 for more information on minimum sample submission requirements and the meaning of type of sample. Permit requirements for a specific waterworks may require more sampling than outlined in the department's monitoring guidelines. If consumers need more information on the nature and significance of specific water tests, for example, "what is the significance of Selenium in a water supply", more detailed information is available from: [http://www.hc-sc.gc.ca/ewh-semt/pubs/water-eau/index\\_e.html](http://www.hc-sc.gc.ca/ewh-semt/pubs/water-eau/index_e.html).

**Water Quality Standards**

**Bacteriological Quality**

| Parameter/Location  | Limit                | Regular Samples Required | Regular Samples Submitted | # of Positive Regular Submitted (%) |
|---------------------|----------------------|--------------------------|---------------------------|-------------------------------------|
| Total Coliform      | 0 Organisms/100 mL   | 52                       | 52                        | 0%                                  |
| E. coli             | 0 Organisms/100 mL   | 52                       | 52                        | 0%                                  |
| Background Bacteria | Less than 200/100 mL |                          |                           |                                     |

**Water Disinfection –**

**Chlorine Residual in Distribution System for Test Results Submitted with Bacteriological Samples**

| Parameter         | Minimum Limit                      | Total Chlorine Residual Range | Free Chlorine Residual Range | # Tests Required | # Tests Submitted | # Adequate Chlorine (%) |
|-------------------|------------------------------------|-------------------------------|------------------------------|------------------|-------------------|-------------------------|
| Chlorine Residual | 0.1 mg/L free OR<br>0.5 mg/L total | 1.23 – 1.81                   | n/a                          | 52               | 52                | 100%                    |

**Water Disinfection - Total Chlorine Residual for Water Entering Distribution System from Waterworks Records-  
From Water Treatment Plant Records**

| Parameter               | Limit (mg/L) | Test Level Range | # Tests Performed | # Tests Not Meeting Requirements |
|-------------------------|--------------|------------------|-------------------|----------------------------------|
| Total Chlorine Residual | at least 0.5 | 1.40 – 1.85      | 365               | 0                                |

A minimum of 0.1 milligrams per litre (mg/L) free chlorine residual is required for water entering the distribution system. Tests are normally performed on a daily basis by the waterworks operator and are to be recorded in operation records. This data includes the number of free chlorine residual tests performed, the overall range of free chlorine residual (highest and lowest recorded values) and the number of tests and percentage of results not meeting the minimum requirement of 0.1 mg/L free chlorine residual. **Water is supplied by the City of Saskatoon and is chloraminated so there is rarely a free chlorine residual. The system operates on total chlorine residual.**

**Turbidity – From Water Treatment Plant Records**

| Parameter | Limit (NTU) | Test Level Range | # Tests Not Meeting Requirements | Maximum Turbidity (NTU) | # Tests Required | #Tests Performed |
|-----------|-------------|------------------|----------------------------------|-------------------------|------------------|------------------|
| Turbidity | 1           | 0.03 – 0.13      | 0                                | 0.13                    | 365              | 365              |

**Chemical – Health Category**

All waterworks serving less than 5000 persons are required to submit water samples for SE's Chemical Health category once every 2 years. The Chemical Health category includes analysis for arsenic, barium, boron, cadmium, chromium, fluoride, lead, nitrate, selenium and uranium.

\* Water is supplied by the City of Saskatoon. Results from these tests can be seen at [www.saskatoon.ca](http://www.saskatoon.ca)



**Saskatchewan  
Ministry of  
Environment**



| Parameter       | Limit<br>MAC(mg/L) | Limit<br>IMAC (mg/L) | Sample<br>Result(s) | # Samples<br>Exceeding Limit |  |
|-----------------|--------------------|----------------------|---------------------|------------------------------|--|
| Arsenic         | 0.010              |                      | n/a                 | n/a                          | * Results expressed as average values for communities or waterworks that fluoridate drinking water supplies or those with elevated concentrations of fluoride or nitrates. |
| Barium          | 1.0                |                      | n/a                 | n/a                          |  |
| Boron           |                    | 5.0                  | n/a                 | n/a                          |  |
| Bromate         | 0.01               |                      | n/a                 | n/a                          |  |
| Cadmium         | 0.005              |                      | n/a                 | n/a                          |  |
| Chlorate        | 1.0                |                      | n/a                 | n/a                          |  |
| Chlorite        | 1.0                |                      | n/a                 | n/a                          |  |
| Chromium        | 0.05               |                      | n/a                 | n/a                          |  |
| Fluoride (avg*) | 1.5                |                      | n/a                 | n/a                          |  |
| Lead            | 0.01               |                      | n/a                 | n/a                          |  |
| Nitrate (avg.*) | 45.0               |                      | n/a                 | n/a                          |  |
| Selenium        | 0.01               |                      | n/a                 | n/a                          |  |
| Uranium         | 0.02               |                      | n/a                 | n/a                          |  |

#### **Chemical – Trihalomethanes (THMs) and Haloacetic Acids (HAAs)**

| Parameter        | THMs<br>Limit (mg/L) | Sample<br>Result (average) | # Samples<br>Required | # Samples<br>Submitted |
|------------------|----------------------|----------------------------|-----------------------|------------------------|
| Trihalomethanes  | 0.0                  | 0.0                        | 4 (1 every 3 months)  | 0                      |
| Haloacetic Acids | 0.0                  | 0.0                        | 4 (1 every 3 months)  | 0                      |

*Note: Only water supplies derived from surface water or groundwater under the influence of surface water are required to monitor for THMs and HAAs. Waterworks using groundwater sources beyond the influence of surface water do not need to report THMs or HAAs since sampling/analysis will not likely have been performed unless otherwise noted in the waterworks permit to operate*

#### **General Chemical**

| Parameter                 | Aesthetic<br>Objectives * (mg/L) | Sample Results<br>(average) | # Samples<br>Required | # Samples<br>Submitted |
|---------------------------|----------------------------------|-----------------------------|-----------------------|------------------------|
| Alkalinity                | 500                              | n/a                         | n/a                   | n/a                    |
| Bicarbonate               | No Objective                     | n/a                         | n/a                   | n/a                    |
| Calcium                   | No Objective                     | n/a                         | n/a                   | n/a                    |
| Carbonate                 | No Objective                     | n/a                         | n/a                   | n/a                    |
| Chloride                  | 250                              | n/a                         | n/a                   | n/a                    |
| Conductivity              | No Objective                     | n/a                         | n/a                   | n/a                    |
| Hardness                  | 800                              | n/a                         | n/a                   | n/a                    |
| Magnesium                 | 200                              | n/a                         | n/a                   | n/a                    |
| PH                        | No Objective                     | n/a                         | n/a                   | n/a                    |
| Sodium                    | 300                              | n/a                         | n/a                   | n/a                    |
| Sulphate                  | 500                              | n/a                         | n/a                   | n/a                    |
| Total dissolved<br>Solids | 1500                             | n/a                         | n/a                   | n/a                    |

All waterworks serving less than 5000 persons are required to submit water samples for SE's General Chemical category once every two years if a ground water source and once per three months every second year if a surface water or blended surface/groundwater source. The General Chemical category includes analysis for alkalinity, bicarbonate, calcium, carbonate, chloride, conductivity, hardness (as CaCO<sub>3</sub>), magnesium, sodium, sulphate and total dissolved solids.


\* Water is supplied by the City of Saskatoon. Results from these tests can be seen at [www.saskatoon.ca](http://www.saskatoon.ca)

\*Objectives apply to certain characteristics of or substances found in water for human consumptive or hygienic use. The presence of these substances will affect the acceptance of water by consumers and/or interfere with the practice of supplying good quality water. Compliance with drinking water aesthetic objectives is not mandatory as these objectives are in the range where they do not constitute a health hazards. The aesthetic objectives for several parameters (including hardness as CaCO<sub>3</sub>, magnesium, sodium and total dissolved solids) consider regional differences in drinking water sources and quality.



**Saskatchewan  
Ministry of  
Environment**



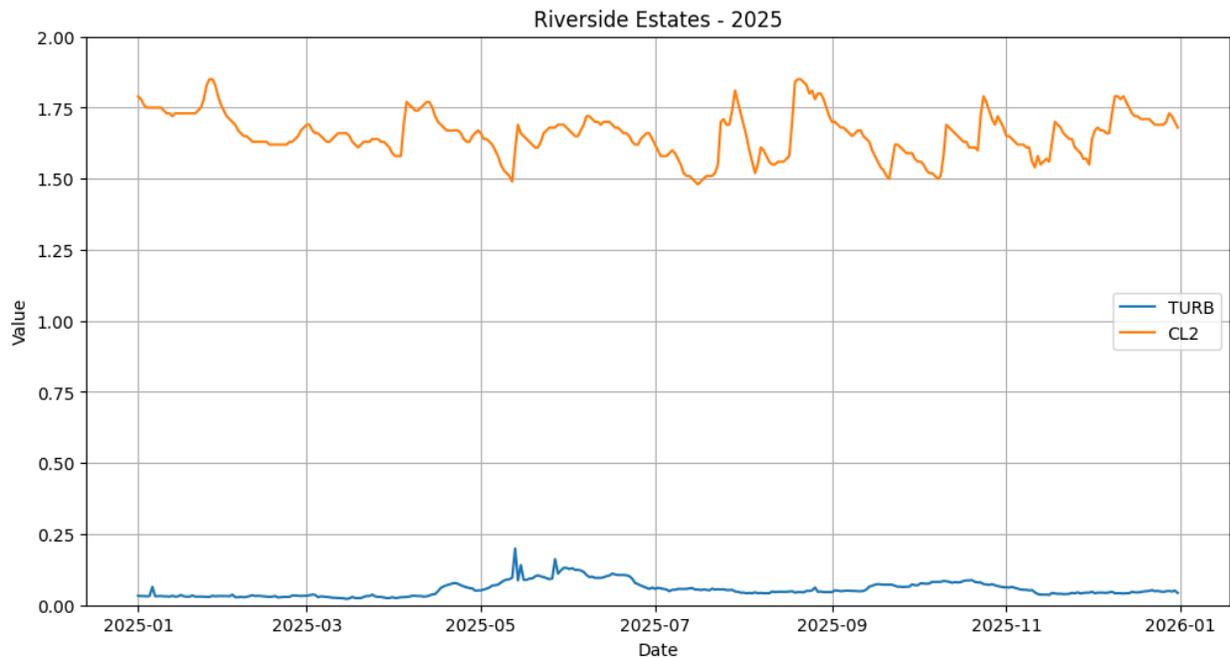

**More information on water quality and sample submission performance may be obtained from:**

Rural Municipality of Corman Park #344  
 111 Pinehouse Drive  
 Saskatoon, SK S7K 5W1  
 Phone: 306-242-9303  
 Fax: 306-242-6965  
[Rm344@rmcormanpark.ca](mailto:Rm344@rmcormanpark.ca)

June 2015    EPB 536D



**Saskatchewan  
 Ministry of  
 Environment**

